

6" COMPOSITE NAIL BASE INSULATION - SEE SPEC
 STANDING SEAM ON FULL COVERAGE ICE & WATER SHIELD
 ROOF EDGE TO BE A 8" S.I.P. TO MATCH COMPOSITE NAIL BASE INSULATION THICKNESS

1-1/2" POLYISOCYANURATE INSULATION R-6.25 PER INCH

CONDUIT ON TOP OF BEAM FOR PENDANT LIGHTS
 1-1/2" WOOD DECKING

SPRAY FOAM SEALED TO ROOF INSULATION

TOP OF WALL 127'-2"
 METAL ROOF EDGE

5/8" WOOD STRIP
 1/2" GWB W/ 1/8" PLASTER SKIM COAT
 1" FINISH FLOOR
 RADIANT TUBING SET IN GYP-CRETE
 1" HIGH DENSITY POLYISO W/ REFLECTIVE FOIL
 1 1/2" X 3 1/2" STRAPPING @ 12" O.C.
 SOUND DEADENING
 BB: (HOMASOTE)
 1 1/2" DECKING

NAIL BASE BOARD SOFFIT
 2X3 NAILER 2' O.C.

04 ROOF EDGE DETAIL
 SCALE: 1 1/2"=1'-0"

2ND FLR. ELEV. 119'-7 1/2"

03 FLOOR EDGE DETAIL
 SCALE: 1 1/2"=1'-0"

CONDUIT RUN

POST BEYOND

3/4" SHIP LAP SIDING
 HOME SLICKER BY BENJAMIN OBDYKE OVER 15# BUILDING FELT

3/4" DIAGONAL SHEATHING
 (4 1/2" NOM.) SPRAY FOAM INSULATION SYSTEM

5" WOOD STUDS 2' O.C.
 2X3 NAILER 2' O.C.

1ST FLR. ELEV. 110'-6 1/4"

RETROFITTED FILT HVA ADHESIVE ANCHORS
 P.T. SILLS: BORATE TREATED
 BG65 EPDM STRUCTURAL GASKETS BY RESOURCE CONSERVATION TECHNOLOGY
 GALV. ANGLE UNDER EPDM GASKET
 6" WIDE SCREEN STRIP FOLDED IN HALF. TYP. @ BOTTOM OF SIDING
 "DURISOL" REINFORCED, INSULATED, FOUNDATION UNITS.
 ENGINEERING BY MANUFACTURER
 PARGE COAT EXTERIOR OF DURISOL

TOP OF FOUN. WALL 108'-10" (DWG. C-1 REF: 1001'-6")
 2" GRANITE

WARM-N-DRI 1-3/16" RIGID FIBERGLASS BOARD
 TUFF-N-DRI FLUID APPLIED ADHESIVE WATERPROOFING- CONNECTING FOUNDATION INSUL TO SPRAY FOAM INSULATION SYSTEM

107'-8" (DWG. C-1 REF: 1000'-4")
 6" X 3 1/2" X 1/2" GALV. ANGLE
 1/2" BOLT EMBEDDED 8" IN CONCRETE
 SPACED @ 24" O.C.
 REMOVE 6"X6" SQUARE OF DURISOL AT EACH BOLT LOCATION


108'-10" (DWG. C-1 REF: 1001'-6")
 2" GRANITE

02 TOP OF FOUNDATION DETAIL
 SCALE: 1 1/2"=1'-0"

BASEMENT ELEV. 100'-0" (DWG. C-1 REF: 992'-8")

FLUID APPLIED ADHESIVE WATERPROOFING

FILTER FABRIC
 STONE
 4" DIA. PERFORATED FOOTING DRAIN

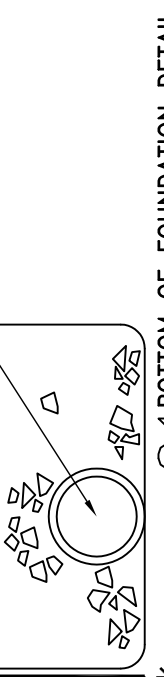

01 BOTTOM OF FOUNDATION DETAIL
 SCALE: 1 1/2"=1'-0"

TOP BLOCK TAPERED TO ALLOW CONCRETE BEARING FOR ABOVE GRADE WALLS

#4 @ 12" O.C.

#5 @ 12" O.C. VERT.
 NOTE: MAXIMUM STONE VENEER HEIGHT NOT TO EXCEED 48"

SEALANT

DATION DETAIL
 -0"

2"x4" WOOD STUD SOFFIT

4" REINFORCED CONC. SLAB
 1/2" INSULTARP-TAPE ALL JOINTS- TURN UP & SEAL @ FOUNDATION WALL
 8" MIN. CRUSHED STONE UNDER VAPOR BARRIER